



This drawing should not be scaled. Dimensions to be verified on site.
Any discrepancies should be referred to the Engineer prior to work being put in hand.
This drawing is the property of Waterman Moylan Consulting Engineers Limited and is issued on the condition that it is not copied, reproduced, retained or disclosed to any unauthorized person, either wholly or in part without the consent in writing of Waterman Moylan Consulting Engineers Limited.
Block 5 East Point Business Park, Dublin D03 H3F4 Ireland
+353 1 864 8900

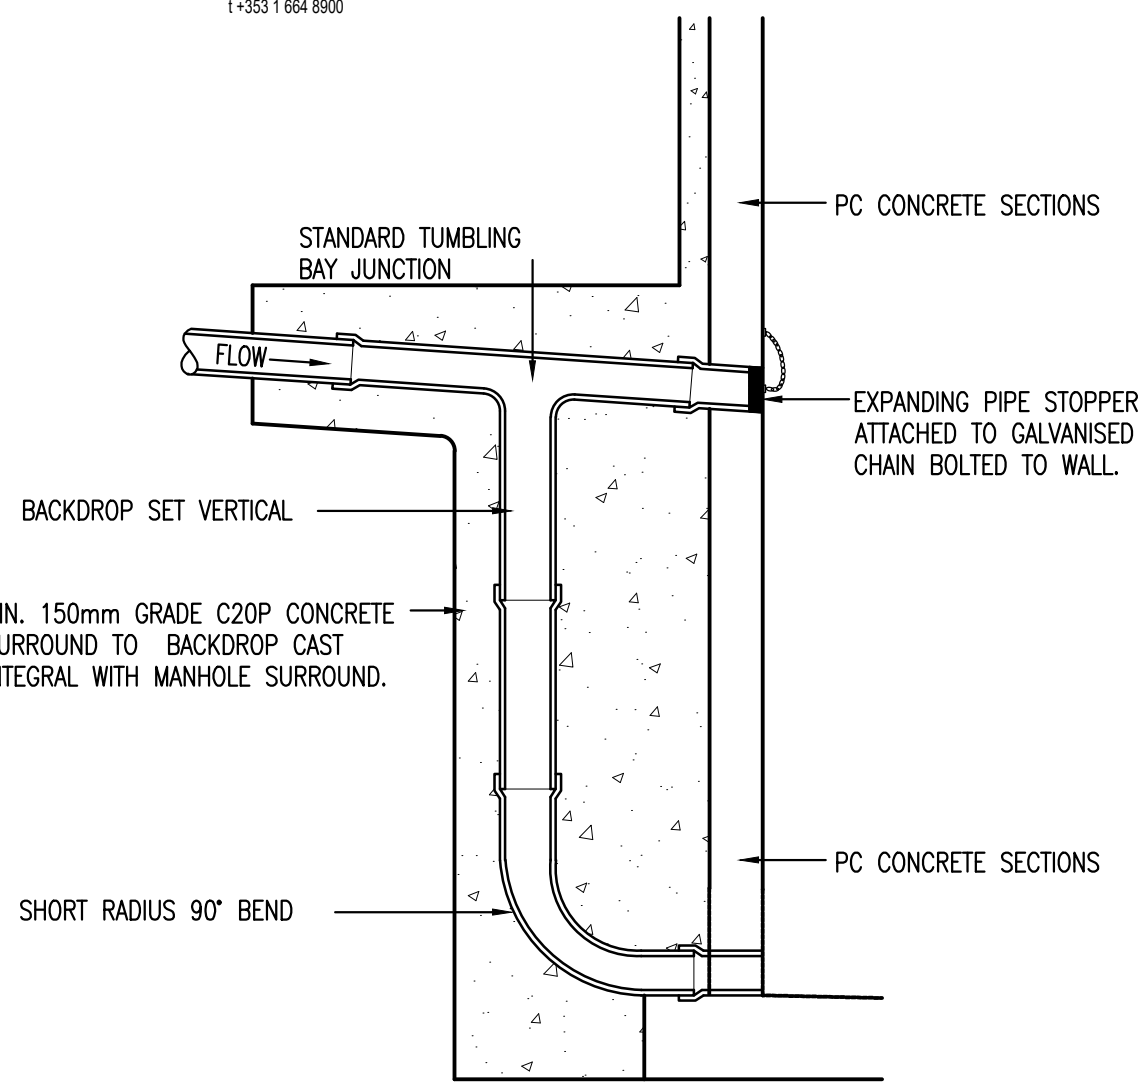

TYPICAL BACKDROP DETAIL


INLET DIA. (mm)	DROP DIA. (mm)
225	300
300	375
375	375
450	450
525	450
600	450
750	600
900	600

490 x 335 MIN. CLEAR OPENING FLAT TOP C.I. GRATING TO I.S./EN 124:1994 CLASS D400 SET 5mm BELOW FINISHED CHANNEL LEVEL AND BEDDED / HAUNCHED WITH CEMENT MORTAR.

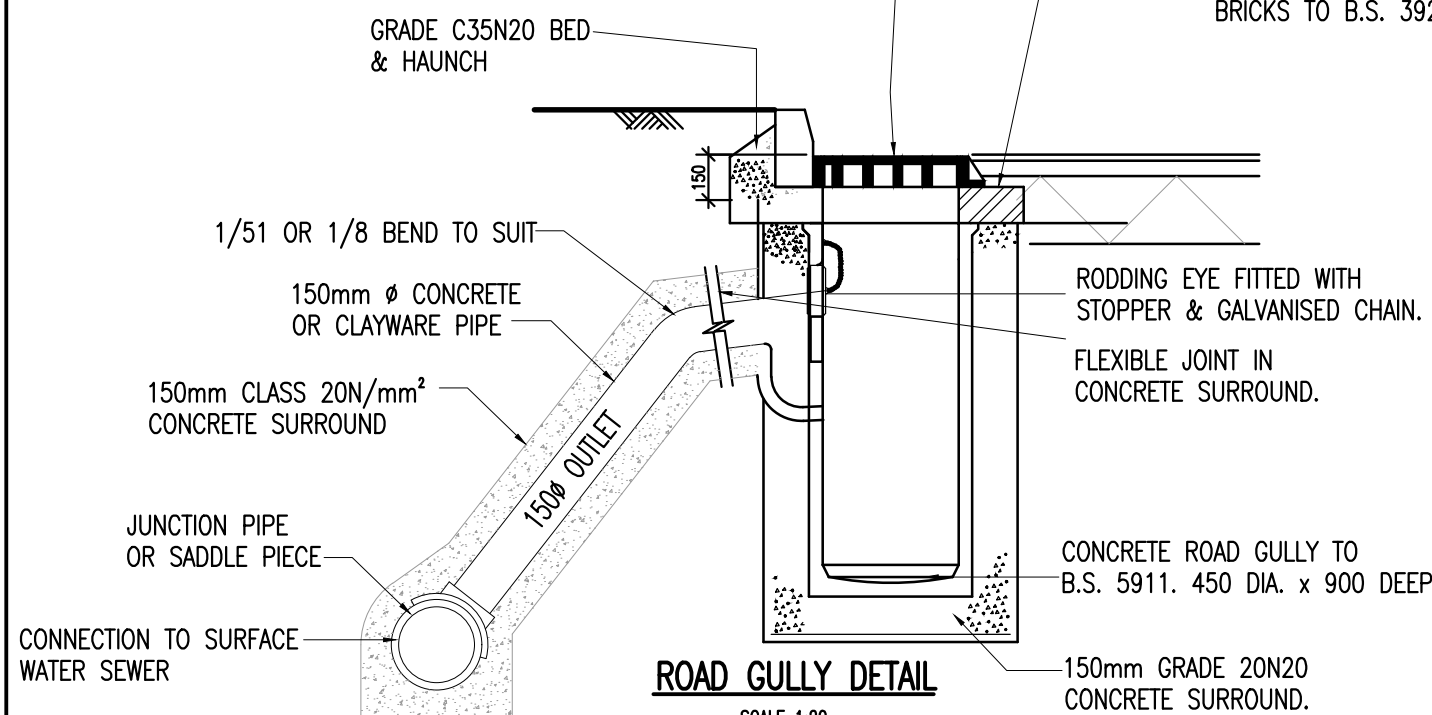


ROAD GULLY DETAIL

SCALE 1:20

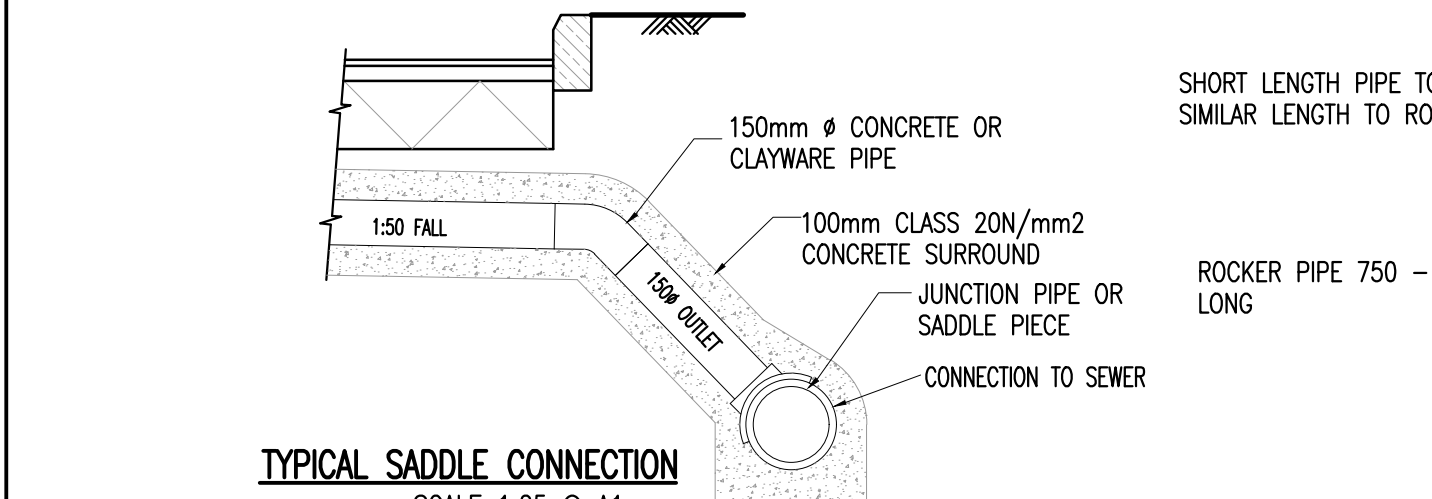

TYPICAL SADDLE CONNECTION

SCALE 1:25 @ A1

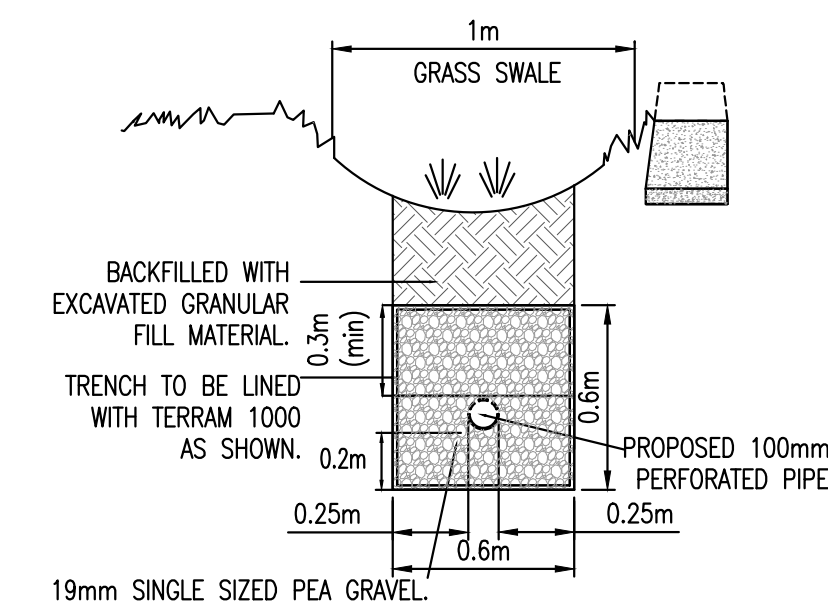


TYPICAL SECTION THROUGH PROPOSED SWALE

SCALE 1:25 @A1

NORMAL INTERNAL DIAMETER	MINIMUM TRENCH WIDTH mm	MAXIMUM TRENCH WIDTH mm
100	450	650
150	500	700
225	600	800
300	700	900
375	950	1150
450	1050	1250
525	1150	1350
600	1250	1450
675	1350	1550
750	1400	1600
825	1500	1700
900	1950	2150
1050	2100	2300
1200	2300	2500
ABOVE 1200	PIPE DIAMETER PLUS 800mm	OUTSIDE DIAMETER PLUS 1000mm

MAXIMUM AND MINIMUM TRENCH WIDTHS

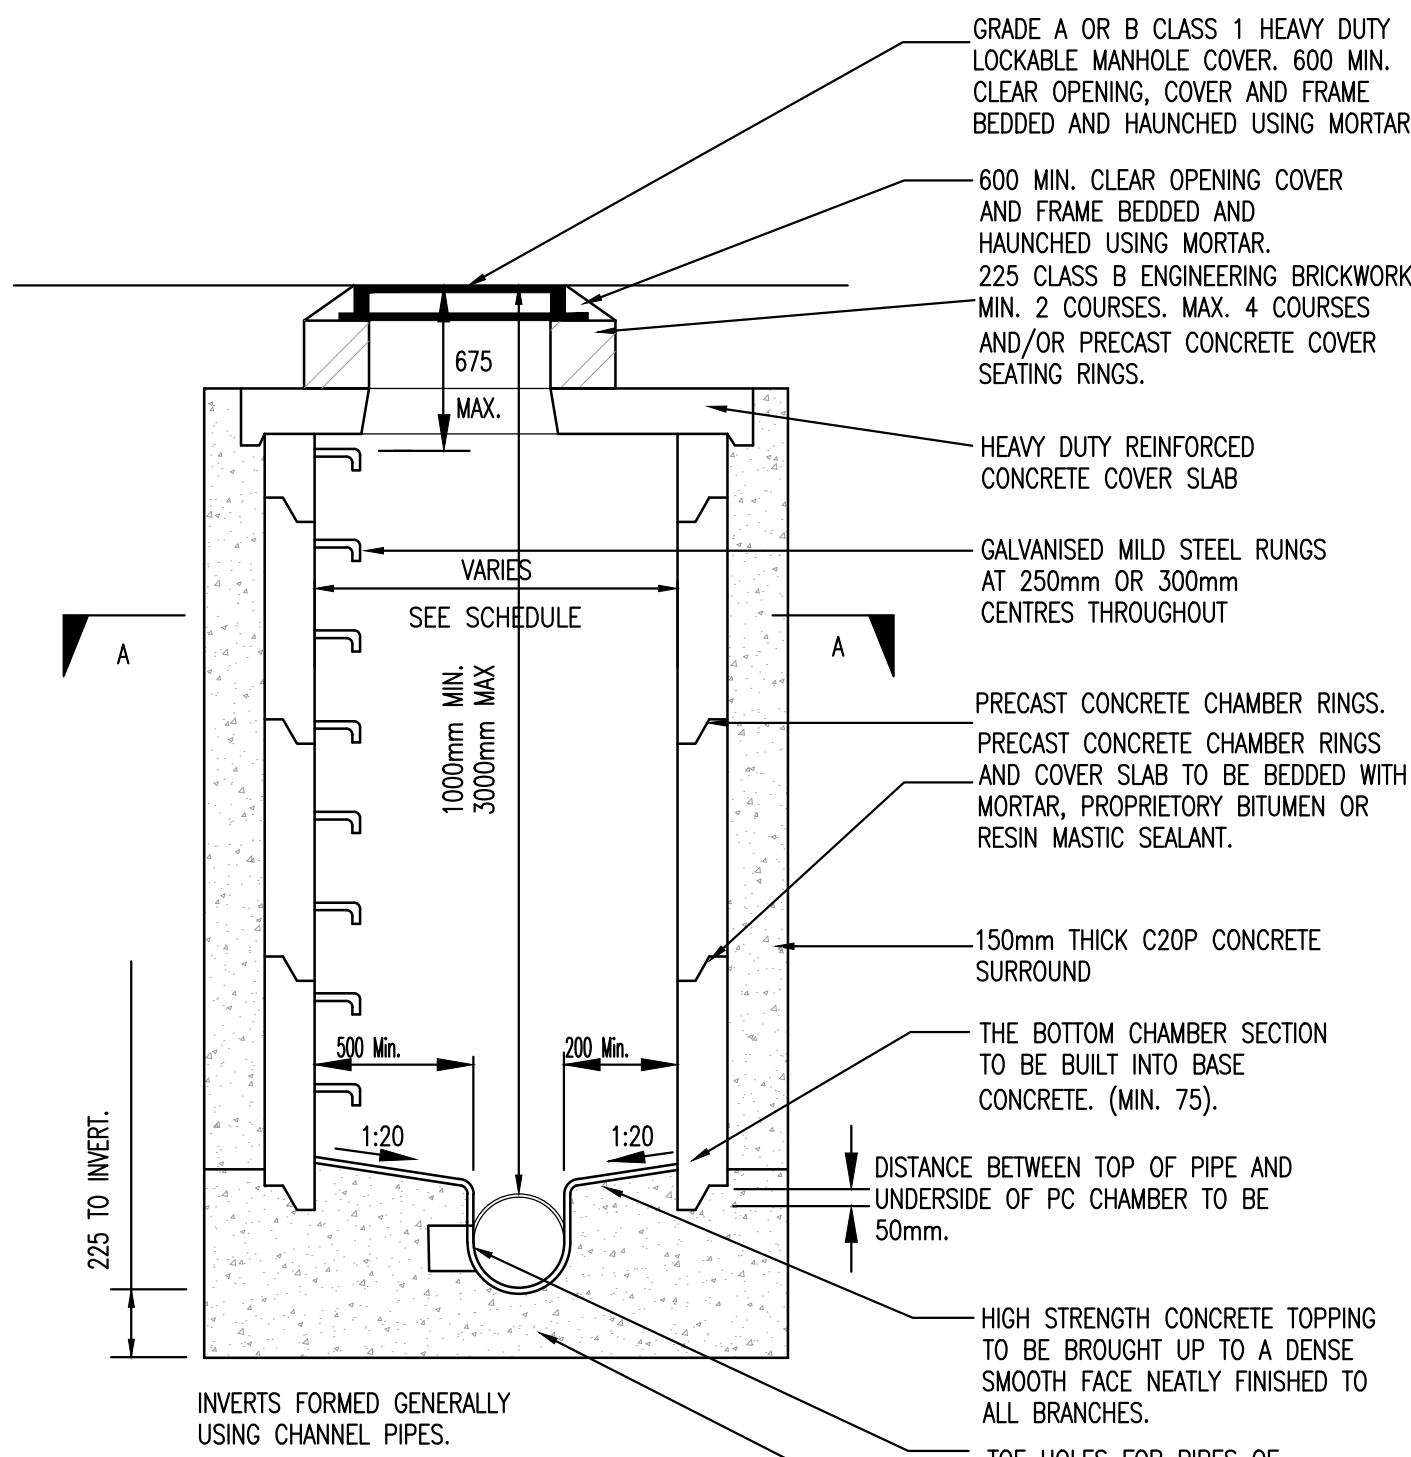


PRECAST CONCRETE RING MANHOLE DETAIL TYPE J (GSDS)


SCALE 1:25

PIPE DIAMETER	ROCKER PIPE LENGTH
150 - 450	0.5 - 0.75
451 - 750	0.75 - 1.0
750 >	SEE GUIDANCE


DIAMETER OF LARGEST PIPE IN MANHOLE	PRECAST CONCRETE RING SIZE
LESS THAN 375mm	1200mm DIA
375mm TO 450mm	1350mm DIA
450mm TO 700mm	1500mm DIA
700mm TO 900mm	1800mm DIA
900mm TO 1200mm	2100mm DIA
1200mm AND ABOVE	2400mm DIA

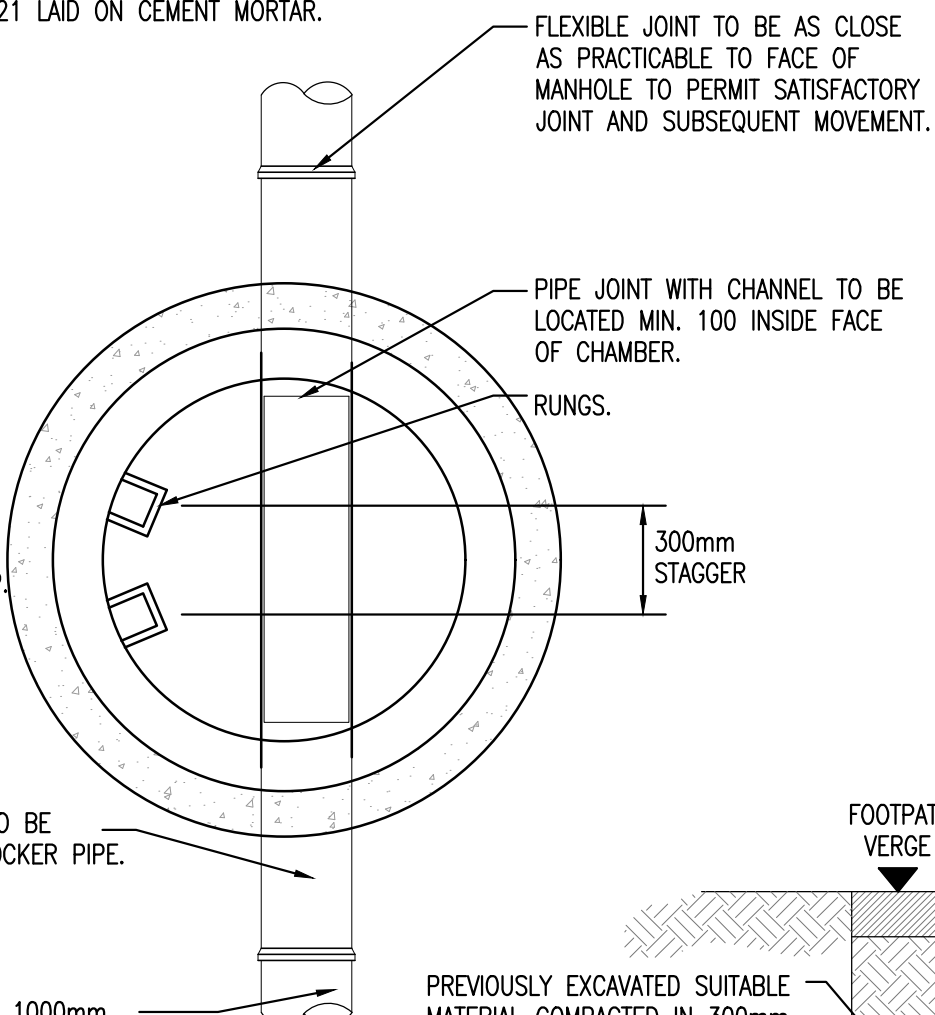



SECTION A-A

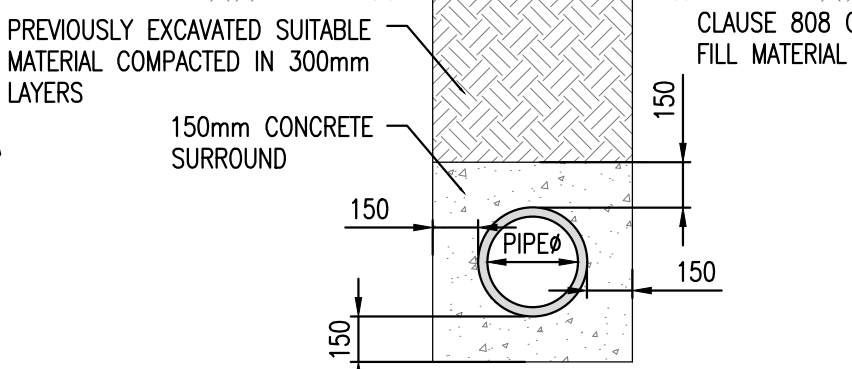


TYPICAL PIPE BEDDING DETAILS NON TRAFFICKED AREAS LESS THAN 900mm TO PIPE CROWN

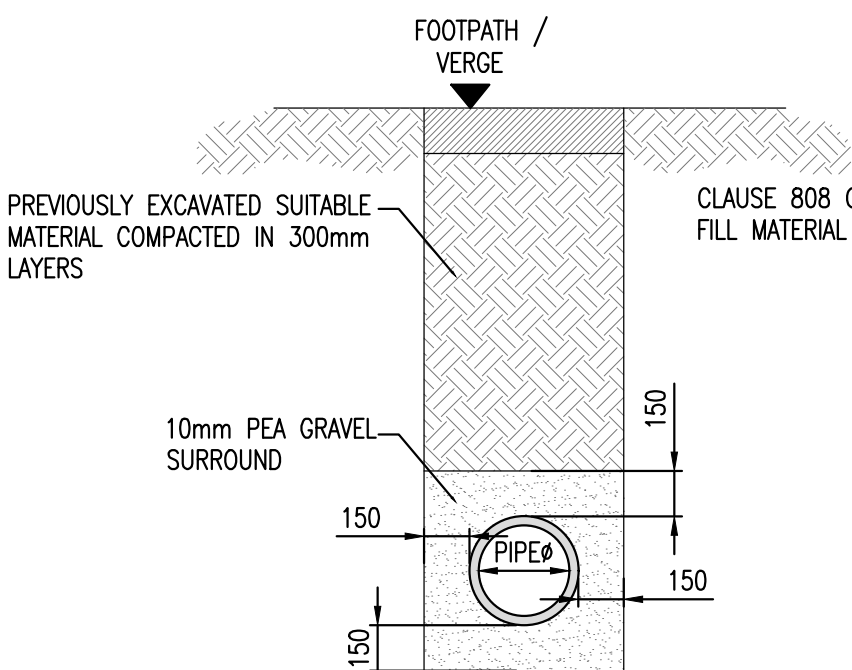


TYPICAL PIPE BEDDING DETAILS NON TRAFFICKED AREAS GREATER THAN 900mm TO PIPE CROWN

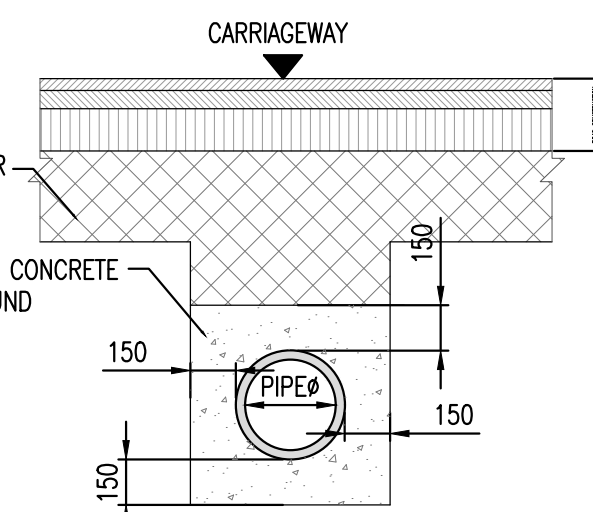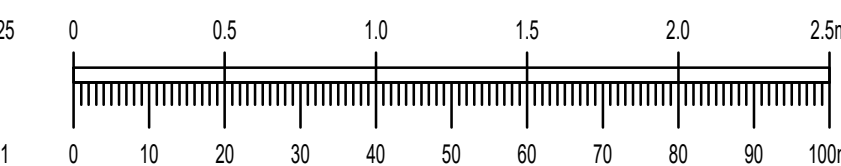

TYPICAL PIPE BEDDING DETAILS TRAFFICKED AREAS LESS THAN 1200mm TO PIPE CROWN

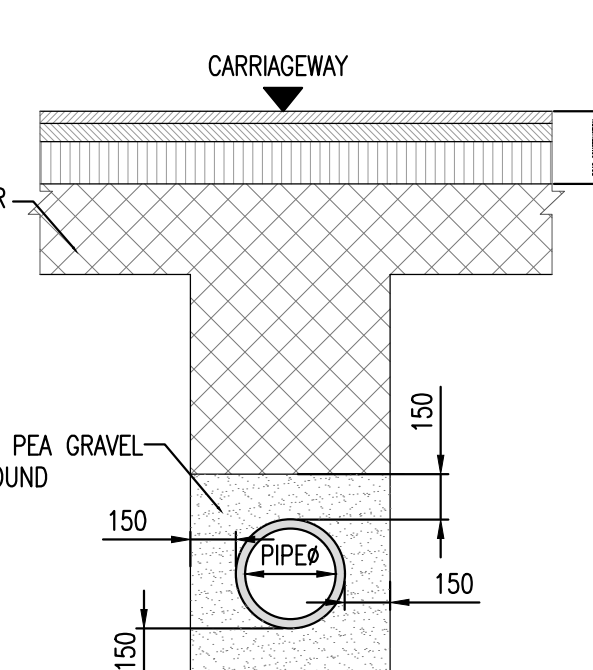


TYPICAL PIPE BEDDING DETAILS TRAFFICKED AREAS GREATER THAN 1200mm TO PIPE CROWN

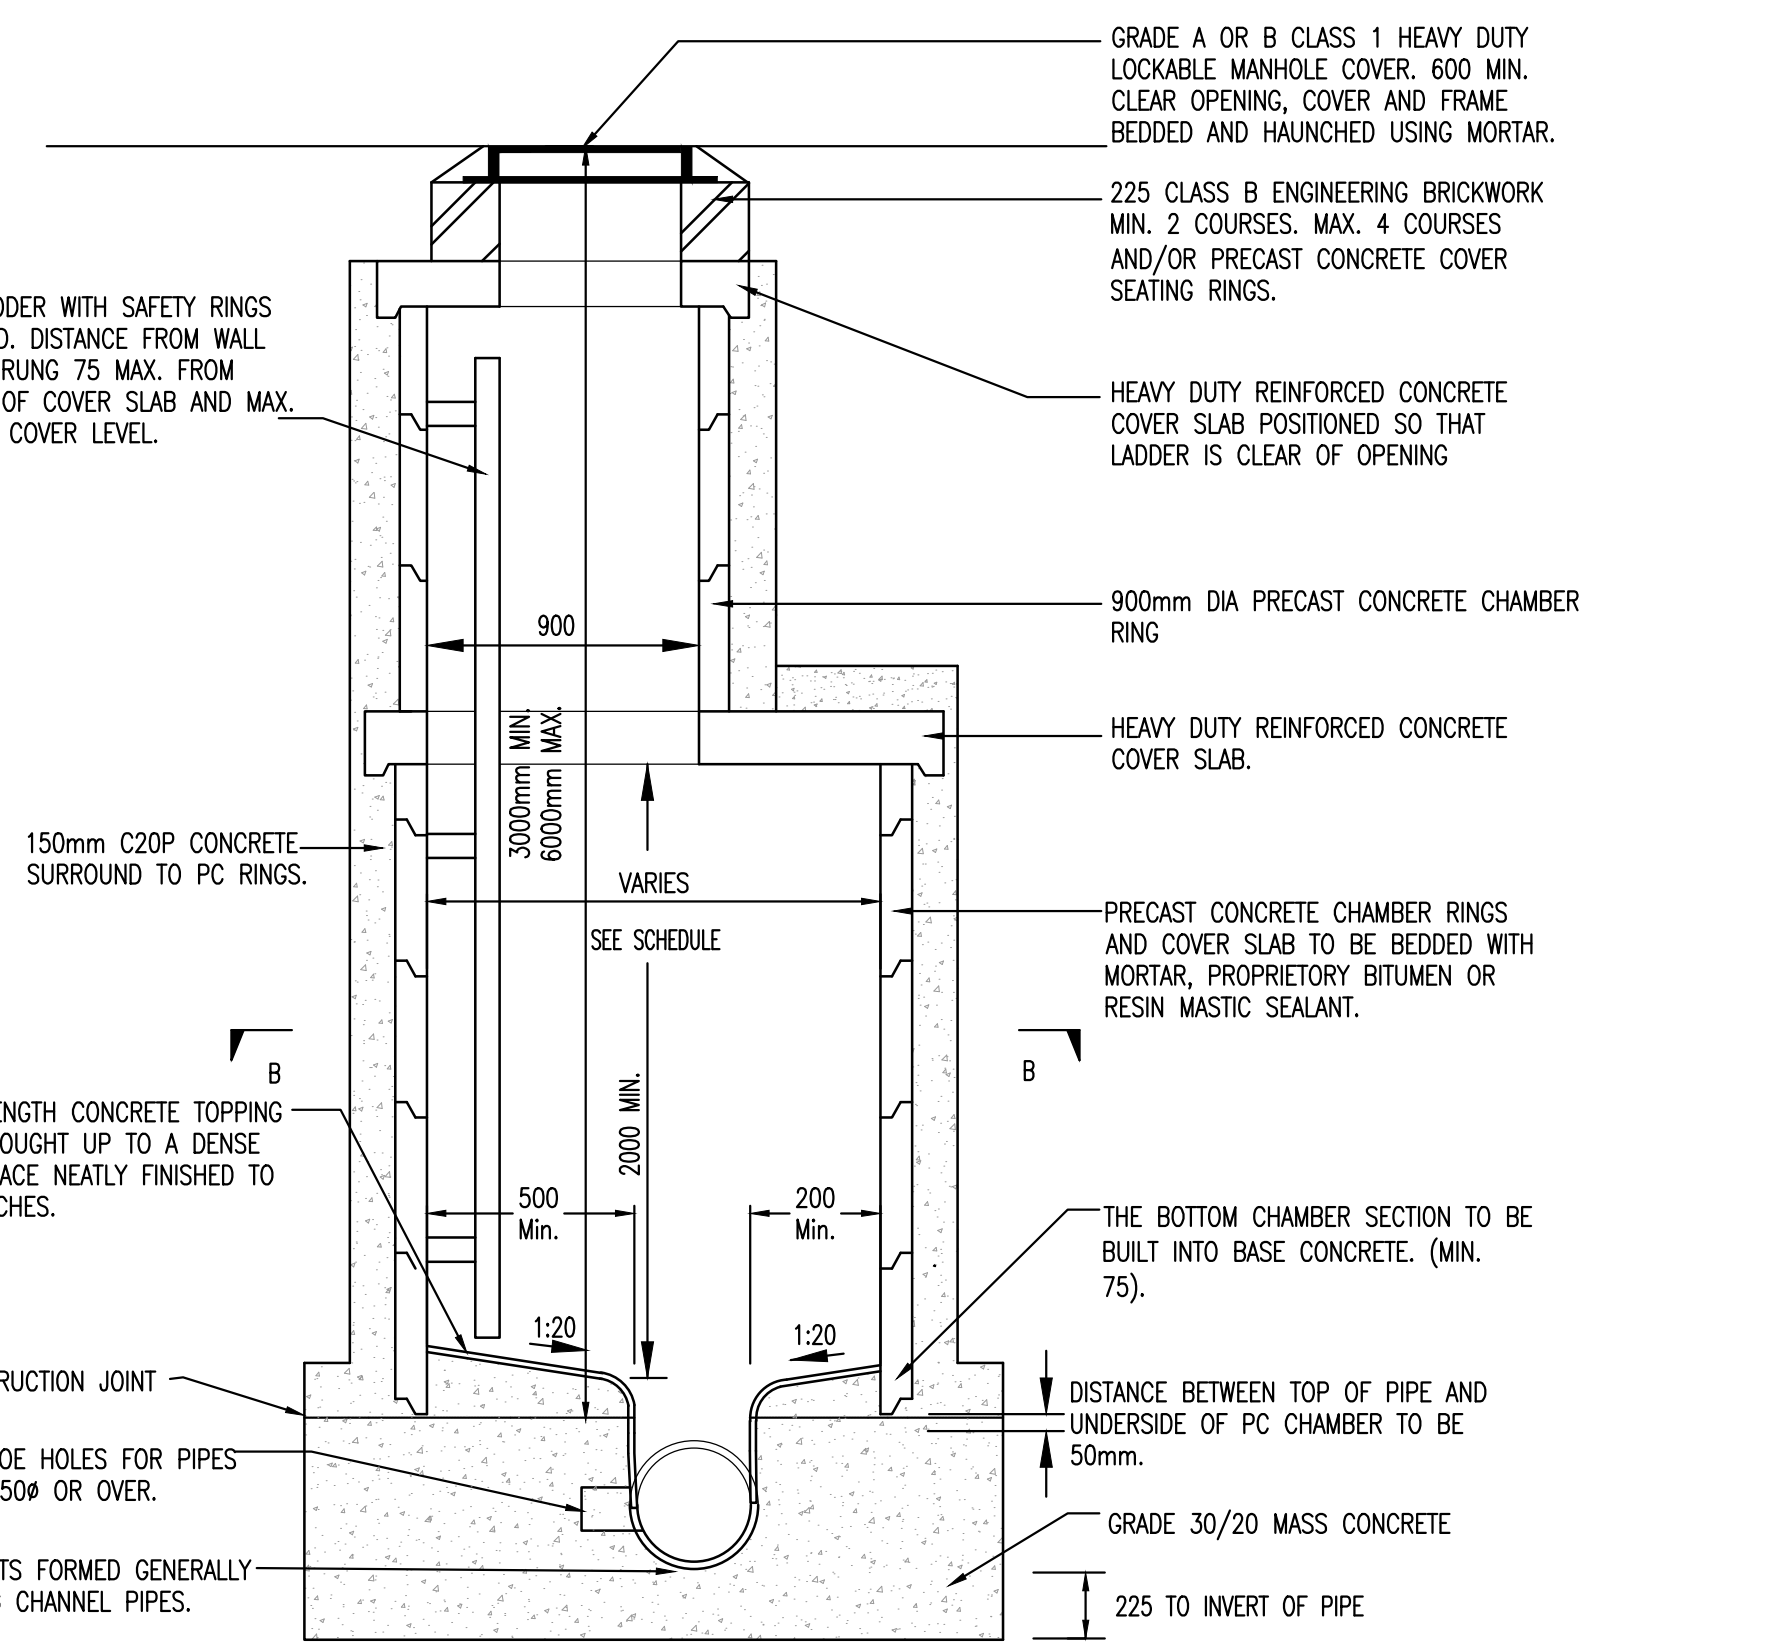

PRECAST CONCRETE RING MANHOLE TYPE K


SCALE 1:25

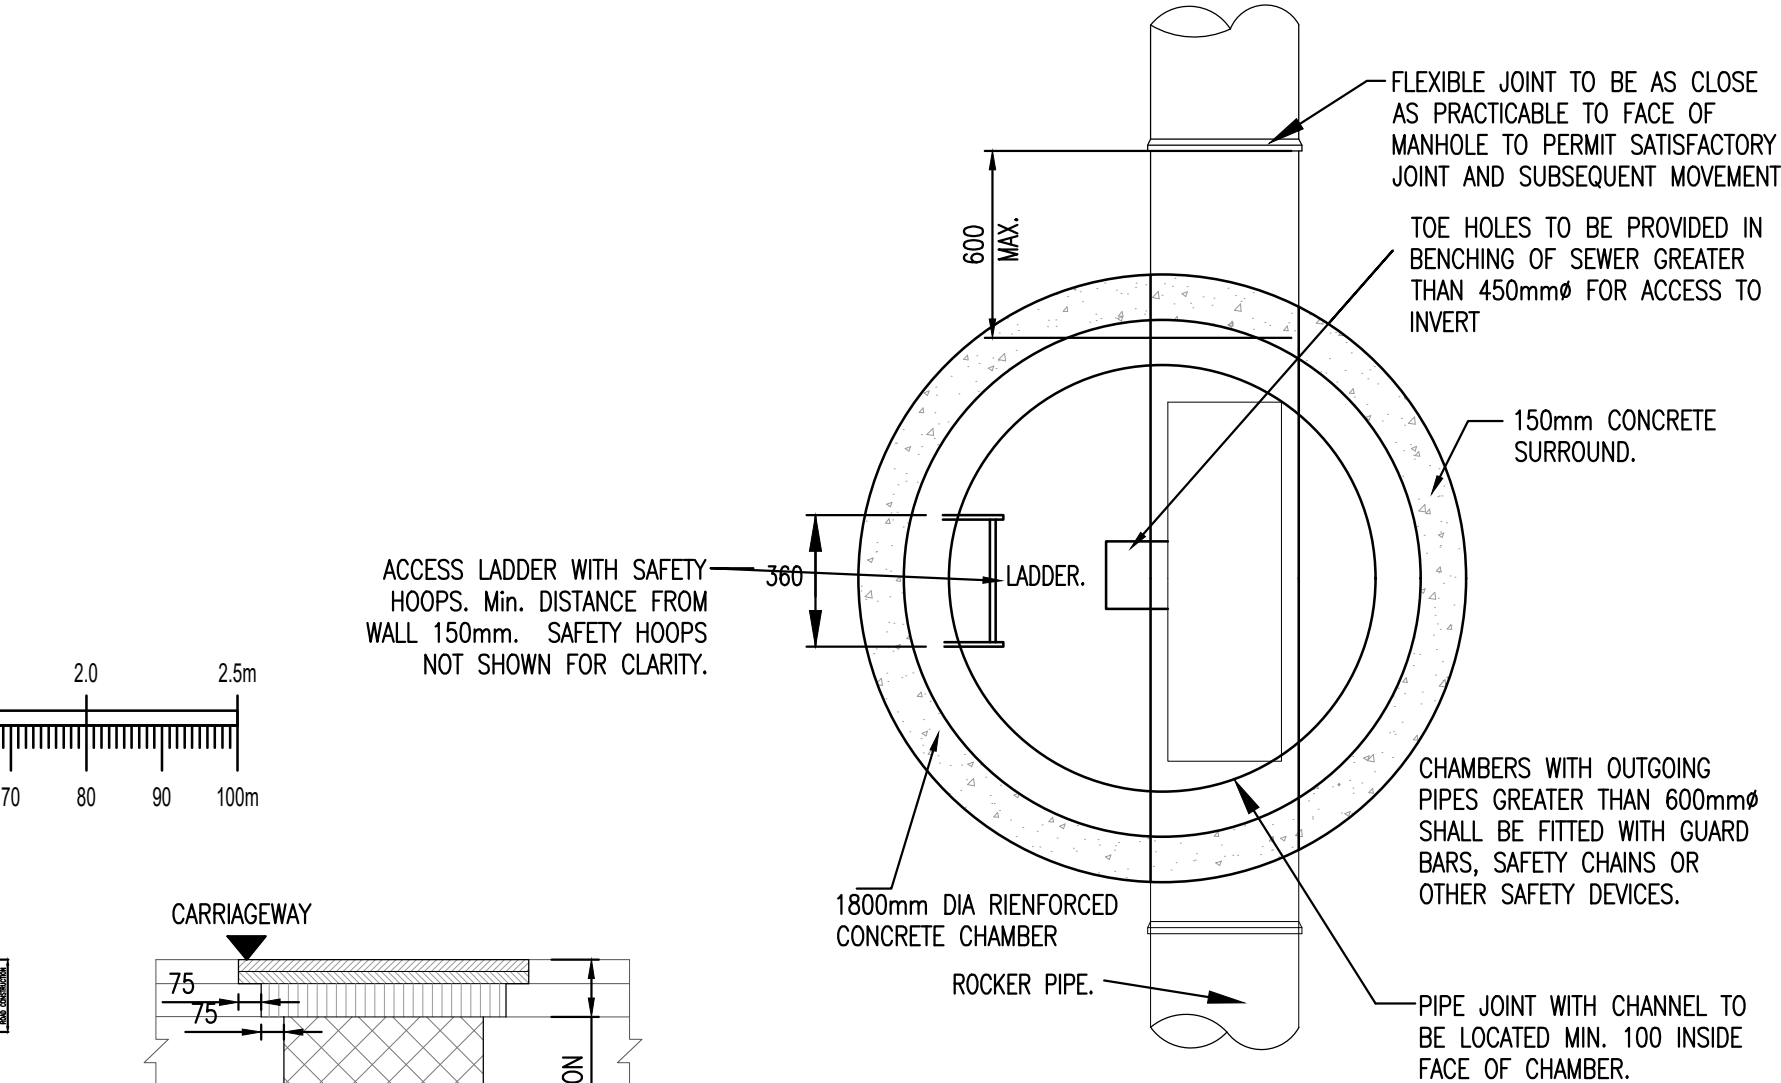


SECTION B-B

TYPICAL PIPE BEDDING AND REINSTATEMENT DETAILS TRAFFICKED AREAS (ROADWAY) LESS THAN 1200mm TO PIPE CROWN

SCALE 1:25

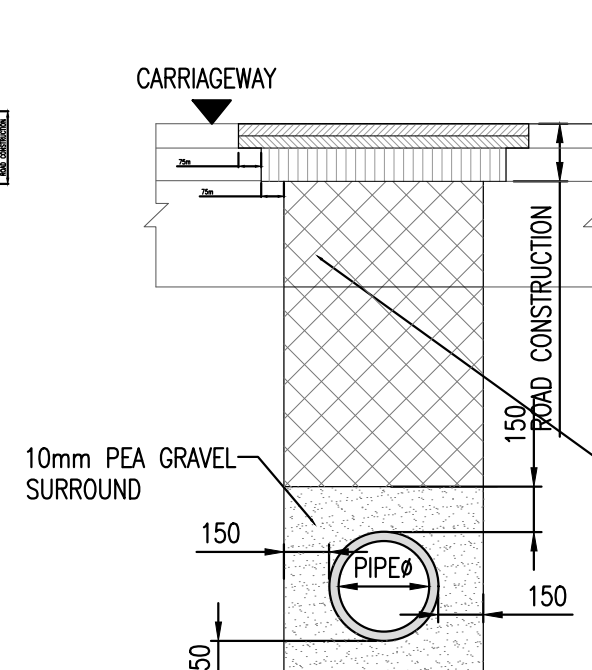

TYPICAL PIPE BEDDING AND REINSTATEMENT DETAILS TRAFFICKED AREAS (ROADWAY)

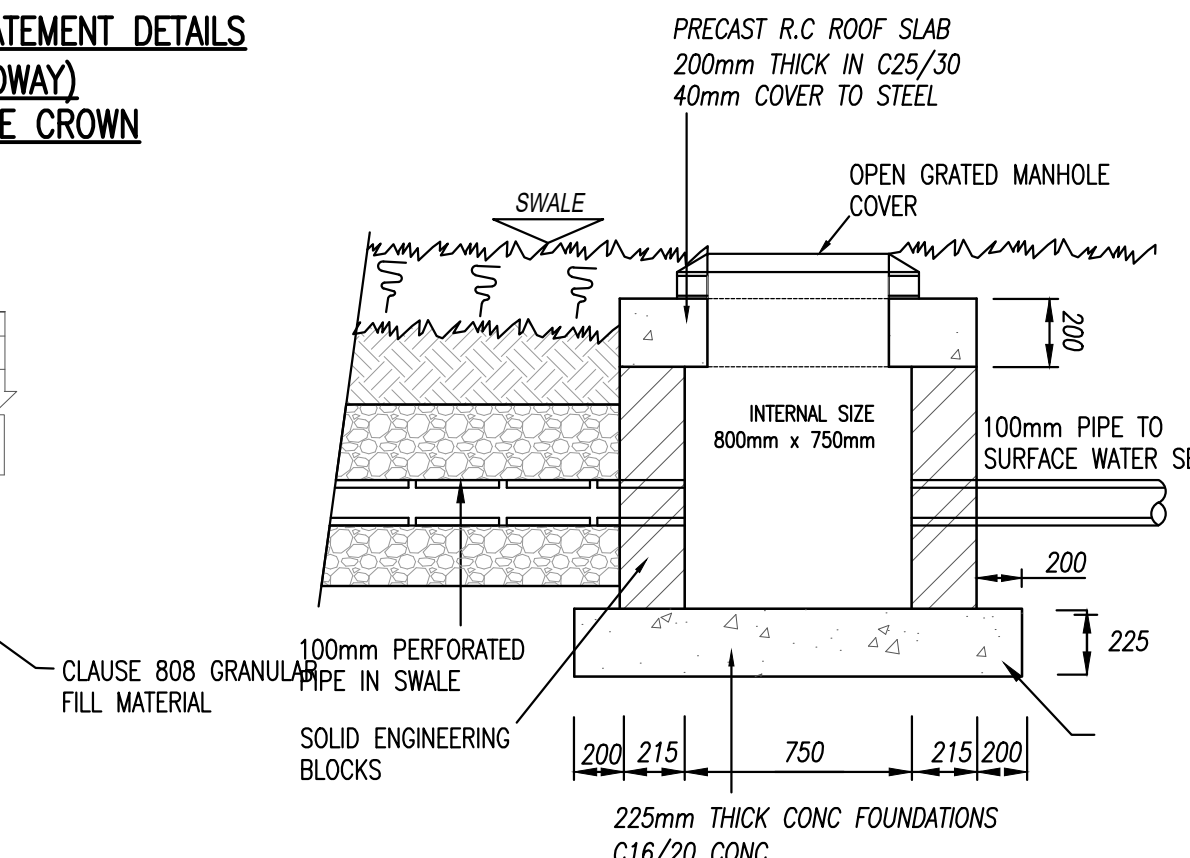

OUTLET MANHOLE IN SWALES

NOTES:

1. DO NOT SCALE. USE FIGURED DIMENSIONS ONLY.

2. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT ARCHITECTURAL AND ENGINEERING DRAWINGS.

3. ALL WORKS SHALL BE CONSTRUCTED STRICTLY IN ACCORDANCE WITH THE REQUIREMENTS OF LOUTH COUNTY COUNCIL.

4. TYPE A GRANULAR FILL SHALL CONSIST OF WASHED PEA GRAVEL. ALL MATERIAL SHALL PASS A 19MM B.S. TEST SIEVE AND SHALL BE RETAINED BY A 4.75MM B.S. TEST SIEVE.

5. SELECTED FILL SHALL BE FREE FROM STONES GREATER THAN 25MM IN SIZE, BUILDERS RUBBISH VEGETABLE MATTER AND LUMPS OF CLAY GREATER THAN 75MM IN SIZE AND SHALL BE COMPACTED IN 150MM LAYERS.

6. WHERE SUITABLE PREVIOUSLY EXCAVATED MATERIAL IS USED FOR BACKFILLING, THIS MATERIAL SHALL BE COMPACTED IN 300MM LAYERS.

7. CONCRETE BED AND SURROUND SHALL BE USED ON ALL PIPES WHERE COVER TO THE SOFT OF THE PIPE IS LESS THAN 1.2M IN ROADS, FOOTPATHS AND GRASS MARGINS AND 0.9M IN OPEN SPACES AND FIELDS.

8. ALL CONCRETE FOR PIPE BEDDING, HAUNCHING AND SURROUNDS SHALL BE GRADE 20N/40 UNLESS OTHERWISE STATED.

9. ALL PIPE TRENCHES / EXCAVATIONS SHALL BE BACKFILLED AND COMPACTED STRICTLY IN ACCORDANCE WITH REQUIREMENTS OF CLAUSE 808, NRA SPECIFICATION FOR ROAD WORKS.

10. ALL HOUSE DRAINS SHALL BE EITHER PVC, CONCRETE OR VITRIFIED CLAY IN ACCORDANCE WITH CURRENT IRISH STANDARDS.

11. ALL FOUL SEWERS SHALL BE EITHER IN-SITU CONCRETE OR BLOCKWORK WITH INTERIOR BRICK LINING.

12. PRIVATE DRAINS SHALL BE DISCONNECTED FROM PUBLIC SEWERS BY THE INSTALLATION OF AN INTERCEPTING TRAP.

13. 225MM. THK. CL. 20/20 MASS CONCRETE FOUNDATIONS.

14. PREFORMED HALF CIRCLE CHANNEL PIPES. THE PIPELINE MAY WHERE PRACTICABLE, BE LAID THROUGH THE MANHOLE AND THE CROWN BROKEN OUT TO HALF DIAMETER, PROVIDED FLEXIBLE JOINTS ARE SITUATED ON EACH SIDE NO FURTHER THAN 600MM. FROM THE INNER FACE OF MANHOLE WALL.

15A. FOR SURFACE WATER MANHOLES HIGH DENSITY BLOCKS TO CL S10 OF IS.20 PART 1 : 1987 OR CL 30/20 INSTITU CONCRETE. BLOCKWORK SHALL BE BEDDED AND JOINTED USING MORTAR DESIGNATION 3 TO IS.406. BEDS AND VERTICAL JOINTS SHALL BE COMPLETELY FILLED WITH MORTAR AS THE BLOCKS ARE LAID. JOINTS SHALL BE FLUSH POINTED AS THE WORK PROCEEDS. ALL FOUL MANHOLES MUST BE FACED IN SOLID ENGINEERING BRICK (MIN. CLASS A OR B) OR INSITU CONCRETE FOR 1 METRE ABOVE BENCHING LEVEL.

15B. FOR MANHOLES > THAN 3m DEPTH TO INVERT USE 30N/20 IN-SITU CONCRETE REINFORCING MESH REF. A393 @ 6.16kg/m TO BE FIXED AT MID POINT OF WALL. ADDITIONAL REINFORCEMENT TO BE SUPPLIED OVER PIPE CROWN.

16. BRICK RELIEVING ARCH 1:13MM. THICK FOR PIPES 225MM. DIAM. OR LARGER. ALTERNATIVELY A REINFORCED CONCRETE LINTEL MAY BE USED. WORK SIZE OF BRICKS 215 X 103 X 65THK. RELIEVING ARCHES USED IN BRICK OR BLOCKWORK MANHOLES.

17. BENCHING AND PIPE CHANNEL PIPE SURROUND - CL. 22.5/20 CONCRETE.

18. BENCHING FINISHED IN 2:1 SAND-CEMENT MORTAR WITH A SMOOTH TROWEL FINISH, LEVEL WITH PIPE SOFFIT AT 1 IN 30 SLOPE TOWARDS CHANNEL.

19. GALVANISED RUNGS AT 3000/C VERTICALLY EMBEDDED TO A DEPTH OF 125mm INTO MANHOLE WALLS. OVER BENCHING AS DIRECTED BY DRAINAGE ENGINEER.

20. OPE. IN ROOF SLAB POSITIONED SO THAT THE EDGE OF OPENING IN THE FRAME IS VERTICALLY ABOVE THE FRONT EDGE OF RUNGS OR LADDERS.

21. 200THK. INSITU R.C. ROOF SLAB IN CL.30/20 CONCRETE. COVER TO STEEL SHALL BE 40MM.

22A. 1 TO 2 NO. ENGINEERING BRICKS CL. B TO I.S. 91: 1983 SET IN 1:3 (CEMENT SAND MORTAR). 22B. AN ACCESS SHIRT 225mm THICK SHALL BE BUILT IN SOLID ENGINEERING BRICK CLASS A OR B OR IN SOLID CONCRETE BLOCKS DESIGNATION S10, STRENGTH 10N/mm2 TO SEAT THE MANHOLE COVER AND FRAME. THE MINIMUM DEPTH OF SHAFT SHALL BE 450mm.

23. GRADE A MANHOLE COVER AND FRAME TO I.S.124: 1994 CLASS D400 NO.2 1988 SET ON 13MM THK. CEMENT MORTAR BED AND FRAMES HAUNCHED OVER SIDES WITH CEMENT MORTAR. MANHOLE COVERS SHALL HAVE A CLEAR OPE. OF 600MM. DIAM. FOR SEWERS LESS THAN 1M. DIAM. MANHOLE COVERS ON SEWERS 1M. DIAM. OR GREATER SHALL HAVE A 600 X 600 CLEAR OPE. MANHOLE COVERS SHALL BE AT LEAST 100MM. DEEP.

24. BACKDROP MANHOLES SHALL HAVE A HEAVY DUTY CLASS D400 COVER AND FRAME FITTED AT GROUND LEVEL TO THE INLET PIPE ON THE BACKDROP.

25. SHORT LENGTH PIPE. PIPE JOINT EXTERNAL TO MANHOLE SHALL NOT EXCEED 600mm FROM THE INNER FACE OF THE MANHOLE WALL. SHORT LENGTH PIPES SURROUNDED IN 150mm THICK CL. 22.5/20 CONCRETE.

26. WHEN DEPTH OF MANHOLES TO INVERT IS GREATER THAN 3.0M. LADDERS SHALL BE USED INSTEAD OF RUNGS. THEY SHOULD BE LOW CARBON STEEL AND HOT DIPPED AFTER FABRICATION.

27. LADDER STRINGERS SHOULD BE ADEQUATELY SUPPORTED FROM THE MANHOLE WALL AT INTERVALS OF NOT MORE THAN 3.0M. STRINGERS SHOULD BE BOLTED TO CLEATS TO FACILITATE RENEWAL.

28. ALL LADDERS, RUNGS, HANDRAILS, SAFETY CHAINS ETC. SHALL BE HOT DIP GALVANISED TO B.S.729.

29. SOCKET OF PIPE MAY BE INSIDE MANHOLE FOR CONVENIENCE OF BRICK ARCH OVER PIPE.

30. ALL MANHOLES SHALL BE WATER TIGHT TO THE SATISFACTION OF THE ENGINEER.

31. FORMWORK TO REINFORCED CONCRETE AND MASS CONCRETE SHALL BE CLASS F2.

32. CLASS U2 FINISH TO THE TOP OF SLABS.

33. PLAN DIMENSIONS OF MANHOLES ARE BASED ON BLOCKWORK HAVING A CO-ORDINATING SIZE OF 450 X 225 X 100.

34. MANHOLES ARE DESIGNED TO B.S.8005 AND WALL THICKNESSES TO I.S.325 TAKING GRANULAR FILL PRESSURE AND H.B. SURCHARGE.

35. REINFORCEMENT TO SLABS TO ENGINEERS DETAILS.

36. CHAMBER SHALL BE FACED INTERNALLY WITH SOLID ENGINEERING BRICKS CLASS A OR B COMPLYING IS 91:1983 TIED INTO BLOCKWORK FOR A HEIGHT OF 1m OVER BENCHING. JOINTS SHALL BE FLUSH POINTED AS THE WORK PROCEEDS.

37. VERTICAL JOINTS SHALL BE COMPLETELY FILLED WITH MORTAR AS THE BLOCKS ARE LAID IN PLACE. MIN. WALL THICKNESS TO BE 225mm.

38. TOE HOLES OF 230mm MINIMUM DEPTH AND GALVANIZE STEEL SAFETY RAILINGS TO BE PROVIDED IN BENCHING AT SEWERS GREATER THAN 525mm DIA. AND DEPTH TO INVERT >3m FOR ACCESS TO INVERT.

39. A SAFETY CHAIN IS TO BE PROVIDED ON PIPES THAT EXCEEDS 450mm DIA. MILD SAFETY CHAIN SHALL BE 10mm NOMINAL SIZE GRADE M (H) NON-CALIBRATED CHAIN, TYPE 1, COMPLYING WITH BS 4942 PART 2 OR EQUIVALENT.

Rev	Date	DESCRIPTION	By	Chk
13/06/25		LAYOUT UPDATES	LS	BG

Amendments

PROPOSED RESIDENTIAL DEVELOPMENT
RATHMULLAN
DROGHEDA

PUBLIC SURFACE WATER DRAINAGE DETAILS

Client: EARLSFORT DEVELOPMENTS DROGHEDA LIMITED

waterman moylan

BLOCK 5, EASTPOINT BUSINESS PARK, ALFIE BYRNE ROAD,
DUBLIN D03 H3F4 IRELAND. Tel: (01) 864 8900
Email: info@waterman-moylan.ie www.waterman-moylan.ie

LRD PLANNING - STAGE 3

Designed By	JG	Approved	JG	Waterman Ref	18-014
Drawn By	G.Byrne	Date	JAN.2025	Drawn By	AS SHOWN @A1

Project	Originator	Volume	Level	Type	Role	Number	Revision
RAT - WMX - PH2 - 00 - DR - C - P457							A